


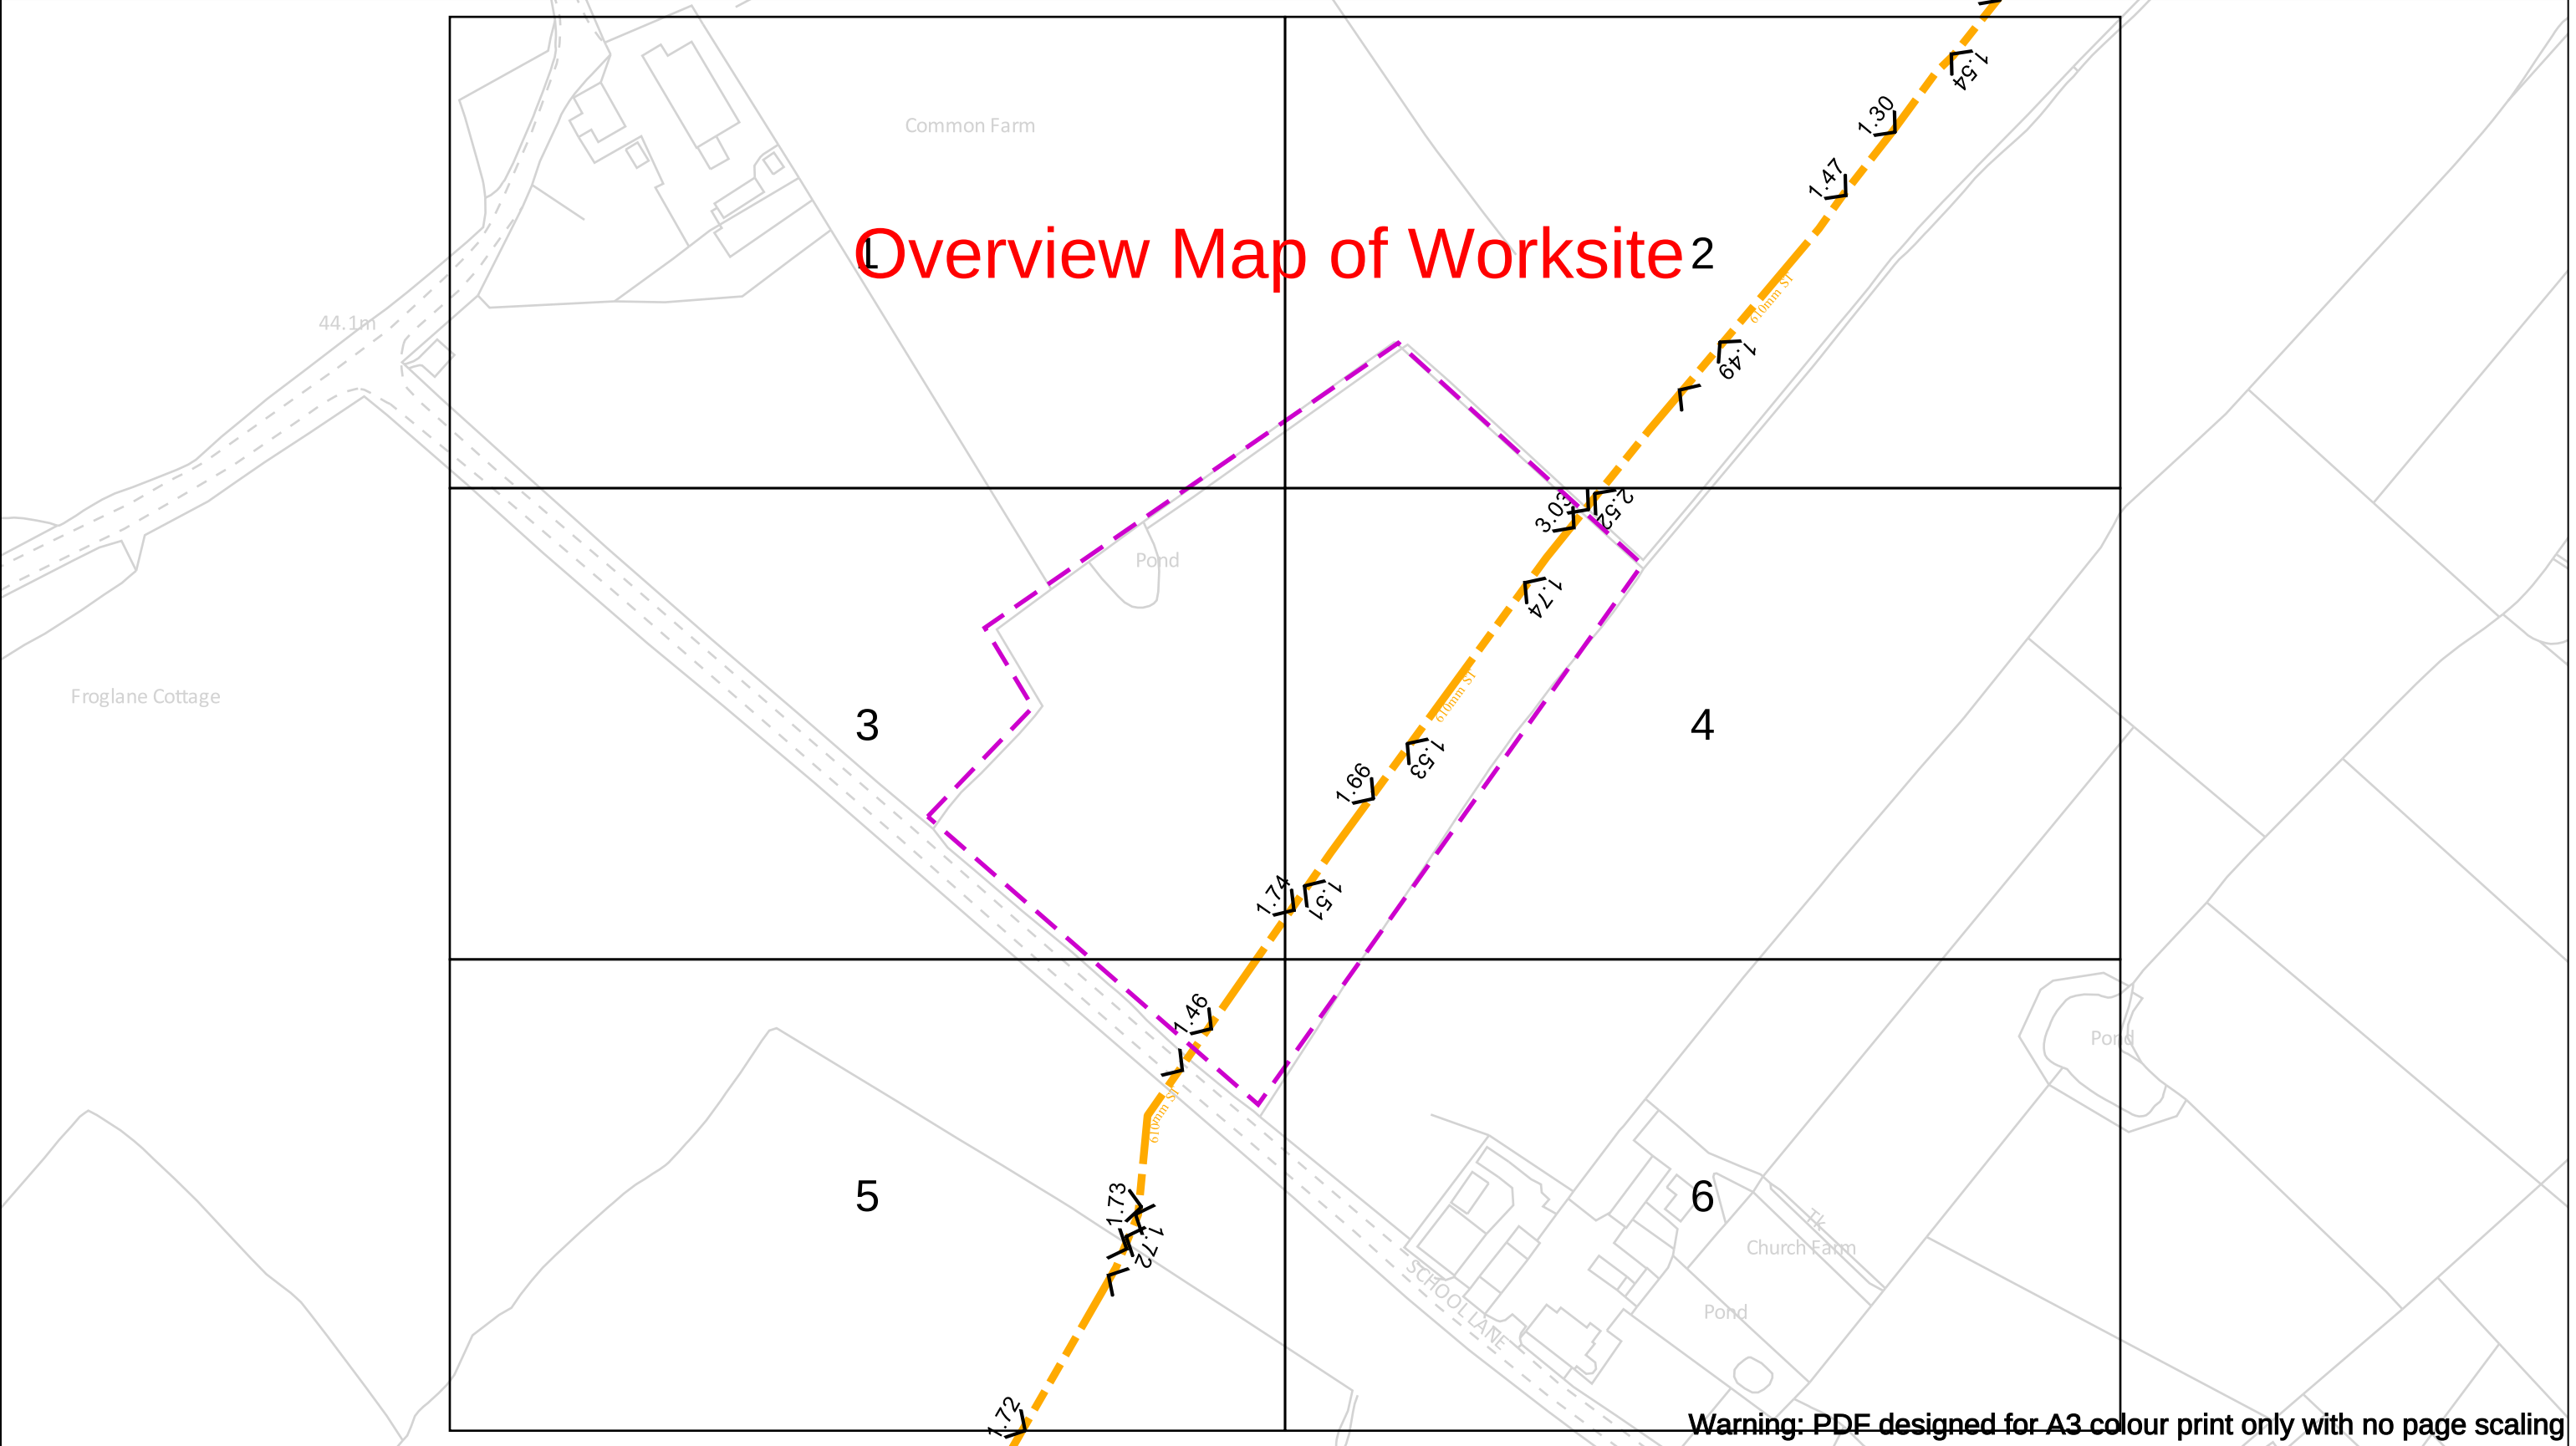

Warning: PDF designed for A3 colour print only with no page scaling

WARNING! This area contains Gas Mains Operating at High Pressure (in excess of 7 bar) and/or Intermediate Pressure (between 2 and 7 bar). Before excavating in the area contact the Plant Protection team on 0800 688 588 or plantprotection@cadentgas.com		In case of an emergency call 0800 111 999		Cadent Your Gas Network																												
Date Requested: 27/05/2025 Job Reference: 37415343 Site Location: 370207 378538 Requested by: Miss Georgie Lee Your Scheme/Reference: CP16783	IMPORTANT NOTICES This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with H5(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.	Dig Sites <table><tr><td></td><td>LP Mains</td><td></td><td>Valve</td><td></td><td>Area: </td><td>Line: </td></tr><tr><td></td><td>MP Mains</td><td></td><td>Depth of cover</td><td></td><td></td><td>Diameter Change</td></tr><tr><td></td><td>IP Mains</td><td></td><td>Material Change</td><td></td><td></td><td>Syphon</td></tr><tr><td></td><td>LHP Mains</td><td></td><td>Out of Standard Service</td><td></td><td></td><td></td></tr></table>			LP Mains		Valve		Area:	Line:		MP Mains		Depth of cover			Diameter Change		IP Mains		Material Change			Syphon		LHP Mains		Out of Standard Service				Where an out-of-standard service is present please contact plant protection 0800 688 588 for further information. Out-of-standard service symbology may be used to indicate one or more of the following: • Identification of shallow services • Identification of dual services • Recording of non-perpendicular services A perpendicular service/connection is laid in a straight line from the entry point at the property to the connection at the main – this includes a pipe that has a perpendicular connection and is not straight but does not deviate more than 1m off centre line.
	LP Mains		Valve			Area:	Line:																									
	MP Mains		Depth of cover			Diameter Change																										
	IP Mains		Material Change			Syphon																										
	LHP Mains		Out of Standard Service																													
Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886																																